



Technical Data

10 Amp - 10 AX Switches

Brief product description:

A standard range of white moulded wall accessories offering superb quality and exceptional value.

The Fan Isolator switch has a triple pole switching design, however can be used for double pole applications if required.

Features:

- BG's Nexus range of plate switches have been designed to perform at 10AX inductive loads.
- A standard design - suitable for domestic or commercial installations.
- The Fan Isolator switch has a triple pole switching design, however can be used for double pole applications if required.

Product Images



911/912/913



914



915



942



943



944



946

Technical Specifications

Standard(s)	BS EN 60669-1
Rating	10 Amp, 250V~(10AX – no derating for inductive or fluorescent loads)
Contact Gap	3.0mm minimum
Terminal Capacity - L & N	4 x 1.0mm ² 4 x 1.5mm ² 2 x 2.5mm ² 1 x 4.0mm ²
RoHS Directive	No
WEEE Directive	No
Mounting Box Depth(Min)	16mm (911W, 912W, 913W, 914W, 915W, 942W, 943W products) 25mm (944W, 946W products)
Fixing Centres	60.3mm (911W, 912W, 913W, 914W, 915W, 942W, 943W products) 120.6mm (944W, 946W products)
Size	86mm x 86mm x 21.2mm (911W, 912W, 913W, 914W, 915W, 942W, 943W products) 146.5mm x 86mm x 21.2mm (944W, 946W products)

10 Amp - 10 AX Switches

Packaging Information

Cat No.	Description	Packaging Type			Pack Quantity			Barcode		
		Product	Inner Box	Outer Box	Each	Inner Box	Outer Box	Individual	Inner Box	Outer Box
911W	10AX 1G,1W	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166911592	5021166911585
912W	10AX 1G,2W	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166912599	5021166912582
913W	10AX Intermediate	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166913596	5021166913589
914W	10AX Bell Push	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166914593	5021166914586
915W	10AX Fan Isolator	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166915590	5021166915583
942W	10AX 2G,2W	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166942596	5021166942589
943W	10AX 3G,2W	Plain Bag	Plain Inner	Plain Outer	1	10	100	/	5021166943593	5021166943586
944W	10AX 4G,2W	Plain Bag	Plain Inner	Plain Outer	1	5	50	/	5021166944590	5021166944583
946W	10AX 6G,2W	Plain Bag	Plain Inner	Plain Outer	1	5	50	/	5021166946594	5021166946587

Weights & Dimensions

Cat No.	Description	Dimension (W x L x H) cm			Weight (g)			CMB (m ³)
		Product	Inner Box	Outer Box	Each	Inner Box	Outer Box	Outer Box
911W	10AX 1G,1W	8.6 x 8.6 x 2.1	12 x 15.8 x 9.2	25.1 x 48 x 16.5	65	650	7400	0.0244
912W	10AX 1G,2W	8.6 x 8.6 x 2.1	12 x 15.8 x 9.2	25.1 x 48 x 16.5	65	650	7450	0.0244
913W	10AX Intermediate		12 x 15.8 x 9.2	25.1 x 48 x 16.5	84	840	10000	0.0244
914W	10AX Bell Push		12 x 15.8 x 9.2	25.1 x 48 x 16.5	59	590	6900	0.0244
915W	10AX Fan Isolator		12 x 15.8 x 9.2	25.1 x 48 x 16.5	83	830	9700	0.0244
942W	10AX 2G,2W	8.6 x 8.6 x 2.1	12 x 15.8 x 9.2	25.1 x 48 x 16.5	84	840	9100	0.0244
943W	10AX 3G,2W	8.6 x 8.6 x 2.1	12 x 15.8 x 9.2	25.1 x 48 x 16.5	9	900	10270	0.0244
944W	10AX 4G,2W		11.6 x 15.1 x 9.2	24.2 x 48.1 x 15.8	126	630	7370	0.02
946W	10AX 6G,2W		11.6 x 15.1 x 9.2	24.2 x 48.1 x 15.8	75	750	9100	0.02

Installation Information

Safety Warning

Before use please read carefully and use in accordance with these safety wiring instructions.

Before commencing any electrical work ensure the supply **is switched off at the mains**. Either by switching off the consumer unit or by removing the appropriate fuse.

Wiring should be in accordance with the latest edition of the IEE regulations (BS 7671).

Wire Identification – Twin & Earth Cable

EARTH = Green/Yellow Sleaving

NEUTRAL = Black (pre Apr 04) / Blue (after Apr 04)

LIVE = Red (pre Apr 04) / Brown (after Apr 04)



Technical Helpline: 0845 194 7584

If in doubt consult a competent electrician.

The ends of the individual conductors should have the insulation removed by approx. 12mm. Any bare earth conductors should be sleeved to within 12mm of the ends. (These details are for general information only and conductor lengths may need to be trimmed in certain installations).

General Installation Instructions

- 1) If using the new product to replace an old one, note the cable connections and wire up new product in the same way as the old one, with Earthing as stated in these instructions.
- 2) Ensure the mounting box (metal or patress) for either flush or surface mounting is the appropriate size for the product.
- 3) Route the cable through the most suitable entry point of the mounting box. If a metal box is used, a protective cable grommet should be used.
- 4) Cables should be prepared so a sufficient conductor length reaches the terminals. Strip the ends of the individual conductors so that an adequate length enters the terminals.
- 5) Carefully arrange the wiring to lie along the edges of the product or box, keeping the central area clear.
- 6) To assist with the correct installation please consult the appropriate wiring diagram on this leaflet.
- 7) When connecting the new accessory ensure that only the bare end of the wire enters the terminal, and no bare wires are visible.

Always tighten the terminal screws securely, but do not overtighten.

An earth connection should always be made between the mounting box earth terminal, and the accessory earth terminal, where fitted. If this earth wire is bare, it is essential that it is sheathed with a length of green/yellow sleaving.

- 8) Carefully position the accessory into the wall box, ensuring that no wires are trapped between the plate and the wall. Do not overtighten the screws. (Fit screw covers + clip-on)

- 9) Once work has been completed correctly, replace the fuse for the circuit, switch the power back on, and test.

The product is now ready for use.

* Note - If your installation uses a four lug metal mounting box, remove the top and bottom lugs or bend fully back.

10 Amp - 10 AX Switches


Installation Information

One Way Switching

One way switching is used in installations that require just one switch to control a light (or circuit) i.e. on or off.


A two-way switch can be used for one-way connection, use COM and L1 terminals.

For multiple gang switches (2, 3, 4 & 6) repeat wiring method for each switch.

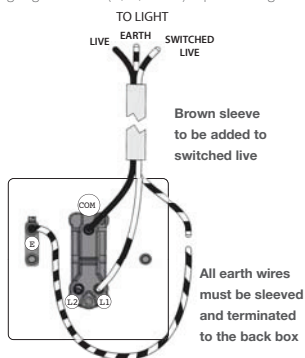

Bell Push


The bell push is a one way switch with a retractive rocker switch. Before installing, ensure a bell unit is suitable for supply voltage.

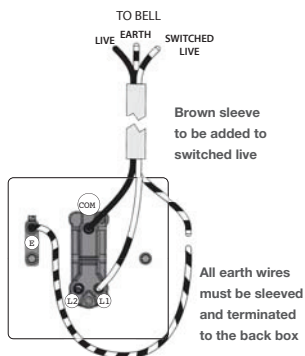

Two Way Switching


Two way switching is used where a light is controlled by two switches.

For multiple gang switches (2, 3, 4 & 6) repeat wiring method for each switch.

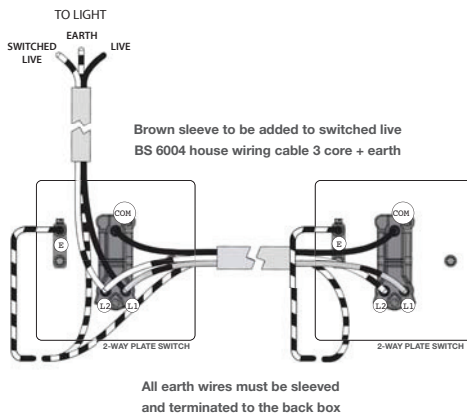

Intermediate Switching

Intermediate switching is used in installations that require three or more switches to control a light, and should be used together with two 2-way switches.

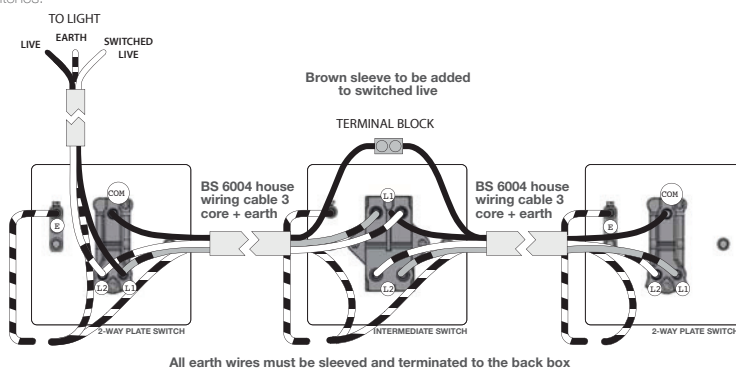

Fan Isolator - 3 Pole Switch

During repair or installation or routine maintenance the power supply to the fan unit must be disconnected. This isolating switch can be installed as shown in the diagrams to enable the remainder of the circuit to remain live.

These instructions should be read in conjunction with the instructions supplied with the fan unit and the latest IEE Wiring Regulations.

Please follow the appropriate wiring diagram below for your particular installation.

Important

The continuity of the protective conductors must be maintained. The isolator switch shall be so situated as to be inaccessible to a person using a fixed bath or shower.

