


Instrument transformer wiring
Tension clamp connection

Test-disconnect terminal blocks

Test-disconnect terminal blocks for measuring with ZTL 6

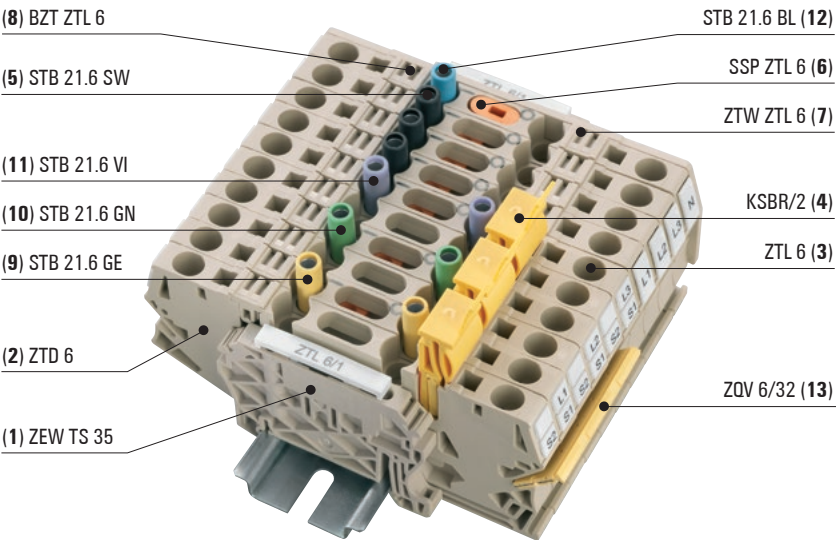

Ordering data

Pos.	Type	Order No.	Qty.
1	ZEW TS 35 (nur TS 35)	9540000000	20
1	EWK1 (nur TS 32)	0206160000	50
2	ZTD 6	1771810000	20
3	ZTL 6	1771800000	20
4	KSBR/2	1771820000	50
5	STB 21.6 SW	1071040000	50
6	SSP ZTL 6	1771860000	100
7	ZTW ZTL 6	1771870000	20
8	BZT ZTL 6	1781140000	20

Optionally available for better labelling (instead of 11 x Pos. 5):

Pos.	Type	Order No.	Qty.
9	STB 21.6 GE	1071010000	50
10	STB 21.6 GN	1071020000	50
11	STB 21.6 VI	1071030000	50
12	STB 21.6 BL	1071080000	50
Optionally available for a shared k-point:			
13	ZQV 6/32 GE	1733640000	10